Ecowatt® Drive K355 Series

Quick Setting Manual



OVERVIEW: This is a basic installation and commissioning steps that must be adhere for quick installation and commissioning.

STEP 1 - UNPACK INSPECTION

Check the following after receiving the product. If found abnormalities, please contact the local dealer or Kruger office.

1.1 Check if the packing box is damaged.
1.2 Check if the interior surface of the packing box is abnormal. For example, in wet condition or whether the enclosure of the VFD is damaged or cracked.
1.3 Check if the accessories inside the packing box are complete (including the manual and keypad).
1.4 Check if the VFD nameplate is consistent with the model identifier on the exterior surface of the packing box and your purchased model.

KRUGER

Model: K355-7R5P-4 IP55
Power: 7.5kW(P)
Input: AC 3PH 380V(-15%)-440V(+10%) 23A 47Hz-63Hz
Output: AC 3PH 0V-Uinput 17A 0Hz-400Hz
S/N:
Made in China

Kruger Ventilation Industries Asia Co., Ltd.

K355-7R5P-4
① ② ③

Field	Sign	Description	Example
Product category	①	Abbreviation of product series	K: Kruger 3: Three phase 55: Ingress protection (IP) rating, IP55
Rated power	②	Power range + load type	7R5: 7.5kW P: Fan and water pump
Voltage level	③	Voltage level	4: AC 3PH 380V (-15%)~440V (+10%)

STEP 2 - INSTALLATION CONFIRMATION

Check the following before VFD installation.

2.1 Ensure that the grid voltage meets input power of VFD.
2.2 Ensure that the output power from VFD is matched with the motor spec.
2.3 Ensure that the environments of installation area are not over the VFD specified limits.

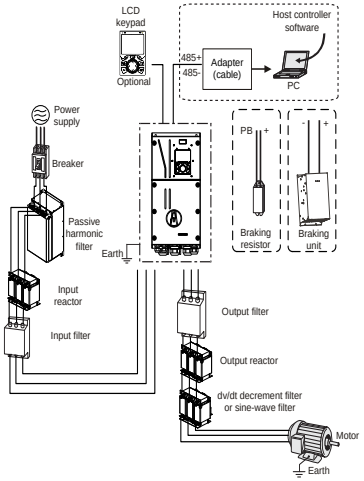

Check the following after the VFD installation.

2.4 Ensure that the correct accessories are selected for the VFD. The accessories are correct and properly installed, and the installation cables meet the requirements of all components (including the input reactor, input filter, output reactor, output filter, DC reactor, braking unit, braking resistor, and so on).
2.5 Ensure that all control cables and power cables are run separately and the routing complies with EMC requirements.

2.6 Ensure that all grounding systems are properly grounded according to the requirements of the VFD.
2.7 Ensure that the external connection terminals of the VFD are tightly fastened and the torque on the bolts are appropriate.
2.8 Ensure that there are screws, cables, or other conductive items are cleared from the VFD. If no, clear them out.

STEP 3 - BASIC COMMISSIONING

Complete the basic commissioning below before the actual use of the VFD. ***(See more details in page no. 2)***

3.1 MOTOR SETTING & AUTO TUNING

↓

3.2 CONTROL METHOD & SETTING

CAUTION: The K355 should ONLY be installed by a qualified electrician.

DANGER! Improper wiring can and will cause bodily harm as well as damage to the equipment.

Ecowatt® Drive K355 Series

Quick Setting Manual

3. BASIC COMMISSIONING (CONTINUE)

You can perform various operations on the VFD by using the keypad, including entering/exiting menus, parameter selection, list modification and parameter addition.



3.1 MOTOR SETTING & AUTO TUNING

1. Select the motor type

Push Manu => Parameter setting => Motor and Encoders parameter setting => Motor1 param => P02.00 motor type
(0: Asynchronous motor, 1: Synchronous motor)

2. Set motor parameters follow Motor's nameplate

- Asynchronous motor_P02.01 to P02.05

Example of setting



P02.01: Rated Power (3.0 kW)
P02.02: Rated Frequency (50 Hz)
P02.03: Rated Speed (2880 rpm)
P02.04: Rated Voltage (400 V)
P02.05: Rated Current (5.7 A)

- Synchronous motor _P02.15 to P02.19

Example of setting



P02.15: Rated Power (4.77 kW)
P02.16: Rated Frequency (50 Hz)
P02.17: Number of Pole Pair (1)*
P02.18: Rated Voltage (400 V)
P02.19: Rated Current (12.5 A)
* 2 pole = 1 pole pair

3. Auto tuning

De-couple the load from motor before start autotuning.
Push Manu => Motor parameters auto tuning =>
1: Rotary auto tuning => Push RUN to start auto tuning
=> Waiting until tuning completed
Note: If cannot be de-coupled motor from the load, please select to perform 2: Static autotuning.

4. Check rotating direction

Push Jogging for 5sec to run motor and check whether the motor rotational direction is correct. If not, change the rotation direction by swapping U⇔W wires of the motor.
or change P00.13 from 0 to 1: Run in reverse direction.

3.2 CONTROL METHOD SETTING

1. Select Start/Stop command method

Push Manu => User defined parameter setting => P00.01: Run CMD channel
(0: Keypad, 1: Terminal, 2: Communication)

P00.01 = 0 : Start/Stop via Keypad
- You can Push RUN or STOP/RST on Keypad directly.

P00.01 = 1 : Start/Stop via Terminal
- Connect 3 switch to terminal S1, S2, S3, COM, PE below.

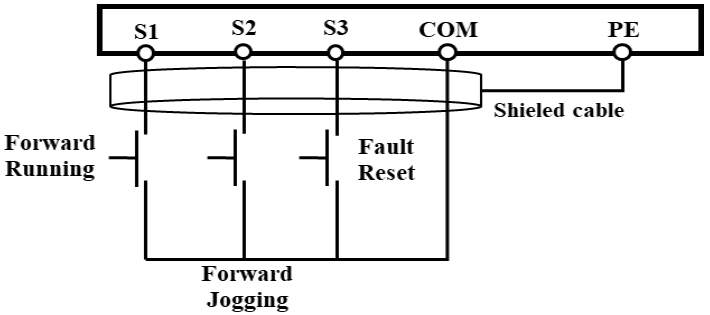

P00.01 = 2 : Start/Stop via Communication (Modbus)
- Connect control cable to 485+, 485-, 485G below.

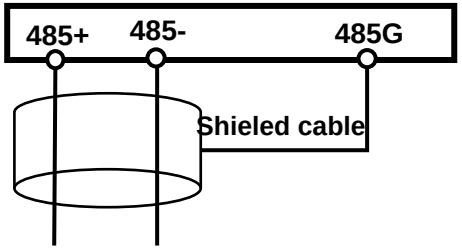

RS485 connect to Controller

2. Select Speed command method

Push Manu => User defined parameter setting
=> P00.06: A Freq CMD
(0: Set via Keypad, 1: Set via AI1)

P00.06 = 0 : Set via Keypad
- You can adjust motor speed / frequency from the Digital Operator on Keypad directly.

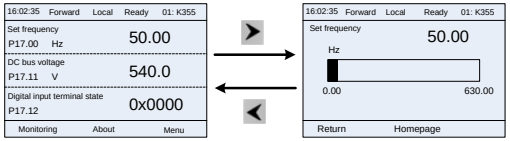

P00.06 = 1 : Set via AI1
- Speed reference from external terminals (Potentiometer or Analog Signal)
Connect cable to 10V, AI1, GND, PE below.

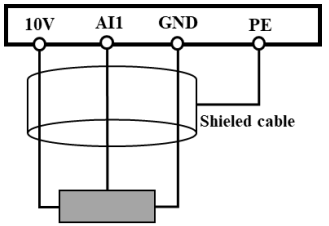

Potentiometer 2K Ohm

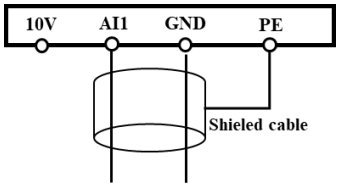

Analog signal 0 - 10V